

# Victaulic® FireLock™ Series FL-QR/ST/ESFR Storage, Fast Response ESFR Pendent Sprinklers K25.2 (36.8)



## 1.0 PRODUCT DESCRIPTION

QUICK RESPONSE STORAGE SPRINKLERS		
SIN	V4802	V4804
SPRINKLER TYPE	NFPA- ESFR	NFPA- ESFR/ FM-Quick Response Storage
SPRINKLER RESPONSE	QR	QR
ORIENTATION	Pendent	Pendent
K-FACTO <sup>1</sup> R	25.2 Imp./36.8 S.I.	25.2 Imp./36.8 S.I.
CONNECTION	25 mm BST/IGS™ Grooved	1"NPT/25 mm BST/IGS™ Grooved
MAX. WORKING PRESSURE	175 psi (1200 kPa)	175 psi (1200 kPa)

AVAILABLE WRENCHES		
SPRINKLER	V46 Open End	3/16 Hex-Bit (V9)
PENDENT	■	■

**Factory Hydrostatic Test:** 100% @ 500 psi/3447 kPa/34 bar


**Min. Operating Pressure:** UL/FM: 7 psi/48 kPa/.5 bar

**Temperature Rating:** See tables in section 2.0

<sup>1</sup> For K-Factor when pressure is measured in bar, multiply S.I. units by 10.0.

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.

## 2.0 CERTIFICATION/LISTINGS



ESFR PENDENT APPROVALS/LISTINGS			
	cULus (NFPA)	FM	cULus (NFPA)
<b>SIN</b>	<b>V4804</b>		<b>V4802</b>
Nominal K Factor Imperial	25.2		25.2
Nominal K Factor S.I. <sup>2</sup>	36.3		36.3
Sprinkler Type	ESFR	Quick Response Storage	ESFR
System Type	Wet		Wet
Temperature Rating	165°F/74°C 212°F/100°C	165°F/74°C 212°F/100°C	155°F/68°C 200°F/93°C
Maximum Area of Coverage	100ft <sup>2</sup> /9.1m <sup>2</sup>		100ft <sup>2</sup> /9.1m <sup>2</sup>
Minimum Area of Coverage	64ft <sup>2</sup> /6m <sup>2</sup>		64ft <sup>2</sup> /6m <sup>2</sup>
Maximum Slope Ceiling	2 in 12/10.5°		2 in 12/10.5°
Maximum Spacing	12ft/3.6m for up to 30ft/9.1m ceiling 10ft/3m for over 30ft/9.1m ceiling	12ft/3.6m for up to 30ft/9.1m ceiling 10ft/3m for over 30ft/9.1m ceiling	12ft/3.6m for up to 30ft/9.1m ceiling 10ft/3m for over 30ft/9.1m ceiling
Minimum Spacing	8ft/2.4m		8ft/2.4m
Deflector to Ceiling Distance <sup>3</sup>	6"-18"/150mm-457mm	4"-17"/100mm-432mm	6"-18"/150mm-457mm
Minimum Deflector to Top of Storage	3ft/0.9m		3ft/0.9m
Minimum Deflector Distance from Walls	4"/100mm		4"/100mm
Sprinkler System Design	12 A.S @ Approved Pressures	12 A.S @ Approved Pressures	12 A.S @ Approved Pressures
<b>Storage Type</b>			
Open Frame (that is, no solid shelves) Single, Double, Multiple-Row, or Portable Rack Storage of Class I-IV and Group A or B Plastics	NFPA 13	Datasheet 2-0	NFPA 13
Solid Pile or Palletized Storage of Class I-IV and Group A or B Plastics	NFPA 13	Datasheet 2-0	NFPA 13
Idle Pallet Storage	NFPA 13	Datasheet 8-24	NFPA 13
Rubber Tire Storage	NFPA 13	Datasheet 8-3	NFPA 13
Rolled Paper Storage (Refer to the standard.)	NFPA 13	Datasheet 8-21	NFPA 13
Flammable Liquid Storage (Refer to the standard.)	NFPA 30	Datasheet 7-29	NFPA 30
Aerosol Storage (Refer to the standard.)	NFPA 30B	Datasheet 7-31	NFPA 30B
Automotive Components in Portable Racks (Control mode only, refer to the standard.)	Refer to NFPA 13	N/A	Refer to NFPA 13


<sup>2</sup> For K-Factor when pressure is measured in Bar, multiply S.I. units by 10.

<sup>3</sup> Distance is taken from the center of the thermal element for FM.

**NOTES**

- Listings and approval as of printing.

2.0 CERTIFICATION/LISTINGS (CONTINUED)



UL SPECIFIC APPLICATION APPROVAL				
Description	Specific Application UL			
Sprinkler Type	ESFR	ESFR	ESFR	ESFR
Temperature Rating °F (°C)	165 °F/74 °C	212°F/100°C	155 °F/68 °C	200°F/93°C
Response Type	ESFR	ESFR	ESFR	ESFR
Sprinkler Position	Pendent	Pendent	Pendent	Pendent
System Type	Wet	Wet	Wet	Wet
Maximum Area of Coverage	100ft <sup>2</sup> /9.1m <sup>2</sup>	100ft <sup>2</sup> /9.1m <sup>2</sup>	100ft <sup>2</sup> /9.1m <sup>2</sup>	100ft <sup>2</sup> /9.1m <sup>2</sup>
Minimum Area of Coverage	64ft <sup>2</sup> /6m <sup>2</sup>	64ft <sup>2</sup> /6m <sup>2</sup>	64ft <sup>2</sup> /6m <sup>2</sup>	64ft <sup>2</sup> /6m <sup>2</sup>
Maximum Slope Ceiling	2 inch rise for 12 inch run	2 inch rise for 12 inch run	2 inch rise for 12 inch run	2 inch rise for 12 inch run
Maximum Spacing	10 ft/3.1m	10 ft/3.1m	10 ft/3.1m	10 ft/3.1m
Minimum Spacing	8 ft/2.4m	8 ft/2.4m	8 ft/2.4m	8 ft/2.4m
Deflector Distance from Walls	4"/100mm	4"/100mm	4"/100mm	4"/100mm
Deflector to Top of Storage	3ft/0.9m	3ft/0.9m	3ft/0.9m	3ft/0.9m
Deflector to Ceiling Distance <sup>3</sup>	6" – 14"/150mm – 355mm	6" – 14"/150mm – 355mm	6" – 14"/150mm – 355mm	6" – 14"/150mm – 355mm
Maximum Ceiling Height	48 ft/14.6m	48 ft/14.6m	48 ft/14.6m	48 ft/14.6m
Maximum Storage Height	43 ft/13.1m	43 ft/13.1m	43 ft/13.1m	43 ft/13.1m
Storage Arrangement	Palletized, solid piled, open frame; single row, double row, or multiple row and portable rack arrangement	Palletized, solid piled, open frame; single row, or double row rack arrangement	Palletized, solid piled, open frame; single row, double row, or multiple row and portable rack arrangement	Palletized, solid piled, open frame; single row, or double row rack arrangement
Commodity	Class I-IV, Cartoned unexpanded plastic	Class I-IV, Cartoned unexpanded plastic	Class I-IV, Cartoned unexpanded plastic	Class I-IV, Cartoned unexpanded plastic
Sprinkler System Design	NFPA 13 for ESFR Sprinklers based upon 45 psi (3.1 bar) design pressure 169 gpm (640 lpm) with 12 sprinkler remote area	NFPA 13 for ESFR Sprinklers based upon 45 psi (3.1 bar) design pressure 169 gpm (640 lpm) with 12 sprinkler remote area	NFPA 13 for ESFR Sprinklers based upon 45 psi (3.1 bar) design pressure 169 gpm (640 lpm) with 12 sprinkler remote area	NFPA 13 for ESFR Sprinklers based upon 45 psi (3.1 bar) design pressure 169 gpm (640 lpm) with 12 sprinkler remote area
Obstruction Criteria	Reference NFPA 13	Reference NFPA 13	Reference NFPA 13	Reference NFPA 13
Minimum Aisle Width	4 ft/1.2m	5 ft/1.5m	4 ft/1.2m	5 ft/1.5m
Hose Stream allowance and Water Supply Duration	250 gpm/950 lpm for 60 minutes or as determined by the approval	250 gpm/950 lpm for 60 minutes or as determined by the approval	250 gpm/950 lpm for 60 minutes or as determined by the approval	250 gpm/950 lpm for 60 minutes or as determined by the approval

<sup>2</sup> For K-Factor when pressure is measured in Bar, multiply S.I. units by 10.

<sup>3</sup> Distance is taken from the center of the thermal element for FM.

NOTES

- Listings and approval as of printing.

### 3.0 SPECIFICATIONS – MATERIAL

#### V4802

**Deflector:** Bronze  
**Load Screw:** Brass  
**Pip Cap:** Brass  
**Spring Seal:** PTFE coated Beryllium nickel alloy  
**Bulb:** 3.0 mm  
**Frame:** Brass  
**Link:** N/A  
**Lever:** N/A  
**Strut:** N/A  
**Coupling:** Refer to Victaulic [publication 10.65](#)  
**Installation Wrench:** Ductile iron  
**Sprinkler Frame Finishes:** Plain brass



#### V4804

**Deflector:** Bronze  
**Load Screw:** Stainless Steel  
**Pip Cap:** Brass  
**Spring Seal:** PTFE coated Beryllium nickel alloy  
**Bulb:** N/A  
**Frame:** Brass  
**Link:** Nickel  
**Lever:** Monel  
**Strut:** Monel  
**Coupling:** Refer to Victaulic [publication 10.65](#)  
**Installation Wrench:** Ductile iron  
**Sprinkler Frame Finishes:** Plain brass

**NOTE**

- For cabinets and other accessories refer to separate sheet.


### 4.0 DIMENSIONS

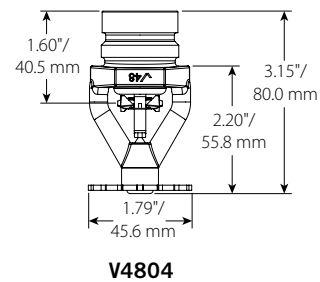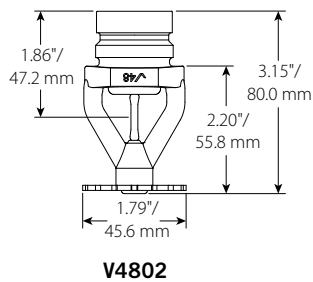

### 5.0 PERFORMANCE

Sprinkler is to be installed and designed as per NFPA, FM Datasheets, or any local standards.

## 6.0 NOTIFICATIONS

<b>⚠ WARNING</b>	
	<ul style="list-style-type: none"> <li>• Read and understand all instructions before attempting to install any Victaulic products.</li> <li>• Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.</li> <li>• Wear safety glasses, hardhat, and foot protection.</li> </ul> <p>Failure to follow these instructions could result in death or serious personal injury and property damage.</p>
<ul style="list-style-type: none"> <li>• These products shall be used only in fire protection systems that are designed and installed in accordance with current, applicable National Fire Protection Association (NFPA 13, 13D, 13R, etc.) standards, or equivalent standards, and in accordance with applicable building and fire codes. These standards and codes contain important information regarding protection of systems from freezing temperatures, corrosion, mechanical damage, etc.</li> <li>• The installer shall understand the use of this product and why it was specified for the particular application.</li> <li>• The installer shall understand common industry safety standards and potential consequences of improper product installation.</li> <li>• It is the system designer's responsibility to verify suitability of materials for use with the intended fluid media within the piping system and external environment.</li> <li>• The material specifier shall evaluate the effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on materials to confirm system life will be acceptable for the intended service.</li> </ul> <p>Failure to follow installation requirements and local and national codes and standards could compromise system integrity or cause system failure, resulting in death or serious personal injury and property damage.</p>	

## 7.0 REFERENCE MATERIALS

**Ratings:** All glass bulbs are rated for temperatures from -67°F/-55°C.

[1-40: Victaulic FireLock™ Automatic Sprinklers Installation and Maintenance Instructions](#)

[1-V9: Style V9 Victaulic FireLock™ IGS™ Installation-Ready™ Sprinkler Coupling Installation Instructions](#)

### User Responsibility for Product Selection and Suitability

Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

### Intellectual Property Rights

No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

### Note

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

### Installation

Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at [www.victaulic.com](http://www.victaulic.com).

### Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

### Trademarks

*Victaulic* and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.